



CITY OF THORNTON, COLORADO

**THORNTON WATER TREATMENT PLANT AND
DISTRIBUTION SYSTEM AUTOMATION PROJECT**

PROJECT NO. 203677

**ADDENDUM NO. 2
TO THE
CONTRACT DOCUMENTS**

June 30, 2026



Bidders on the above-named project are hereby notified that the Bidding Documents are modified as indicated below. Bidders are required to acknowledge receipt of this Addendum in the space provided on the Bid Form.

This Addendum shall become part of the Contract and provisions of the Contract apply.

DRAWINGS

The following drawings are modified as indicated below.

1. DRAWING D209A:
 - a. REPLACE drawing in its entirety with the attached drawing.
2. DRAWING I055:
 - a. REPLACE drawing in its entirety with the attached drawing.

KEYED NOTES:

1 REPLACE EXISTING MANUAL BALL VALVE WITH ELECTRIC ACTUATED BALL VALVE. SODIUM HYPOCHLORITE BALL VALVES SHALL HAVE VITON SEAL, TEFLON SEAT, AND PVC BODY. SODIUM HYPOCHLORITE BALL VALVES SHALL BE SELF VENTING WHEN CLOSED. SUPPORT VALVE AND ACTUATOR SO PIPE IS NOT LOADED.



no.	date	by	ckd	description
0	12/7/18	JS	AB	WP3 - ISSUED FOR CONSTRUCTION
1	4/26/21	LG	EH	CONFORMING TO CONSTRUCTION RECORDS
2	5/29/26	JR	SB	ISSUED FOR BID
3	6/30/26	BE	WS	BID ADDENDUM 2



J PHOTO
D209 SCALE: NONE



K PHOTO
D209 SCALE: NONE

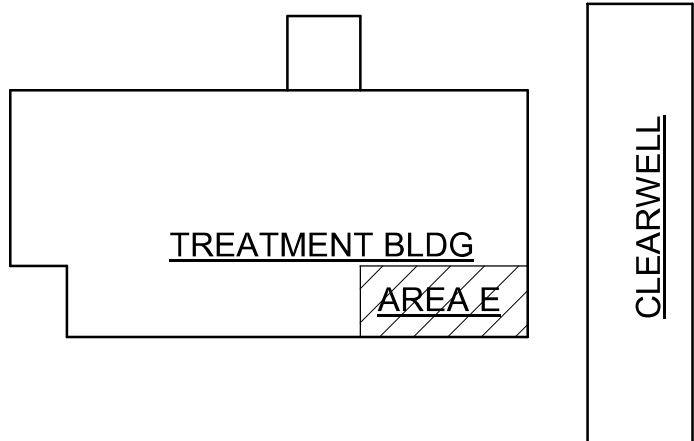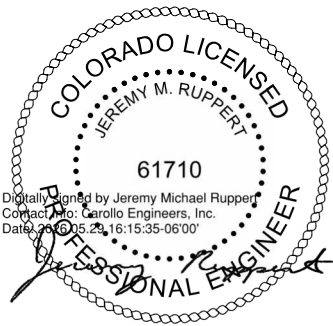

date MAY 29, 2026	detailed D. COSME
designed J. RUPPERT	checked S. BLAIR



CITY OF THORNTON TTP - PACKAGE 3 UPPER LEVEL PLAN AREA E PHOTOS	
project 98101	contract
drawing D209A	rev. 2
sheet file	of sheets

